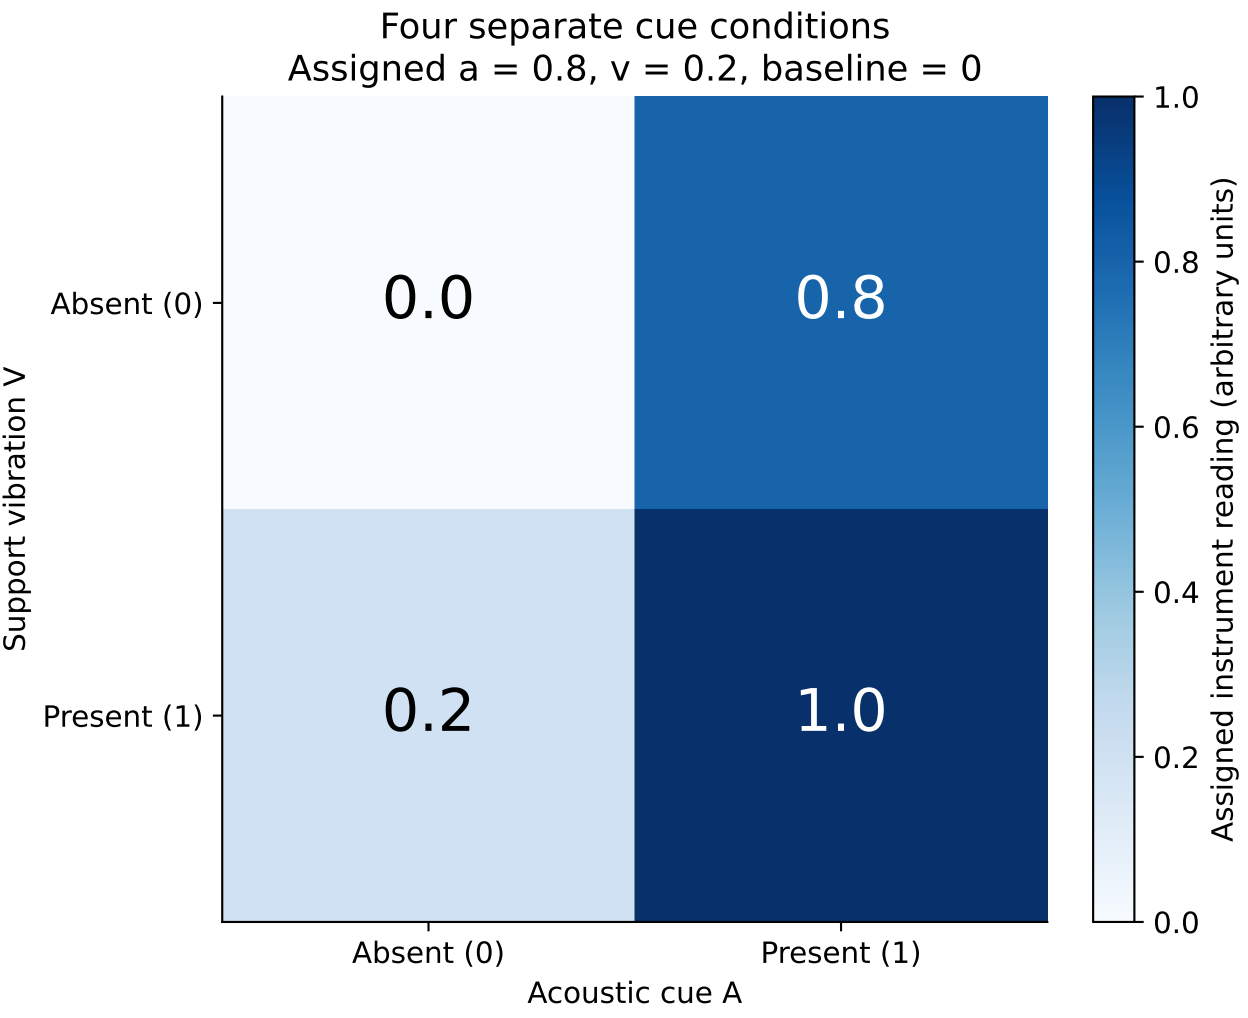

Four separate cue conditions
Assigned a = 0.8, v = 0.2, baseline = 0
0.0
0.8
0.2
1.0
Absent (0)
Present (1)
Support vibration V
Absent (0)
Present (1)
Acoustic cue A
Assigned instrument reading (arbitrary units)
1.0
0.8
0.6
0.4
0.2
0.0